


NFP 92-503

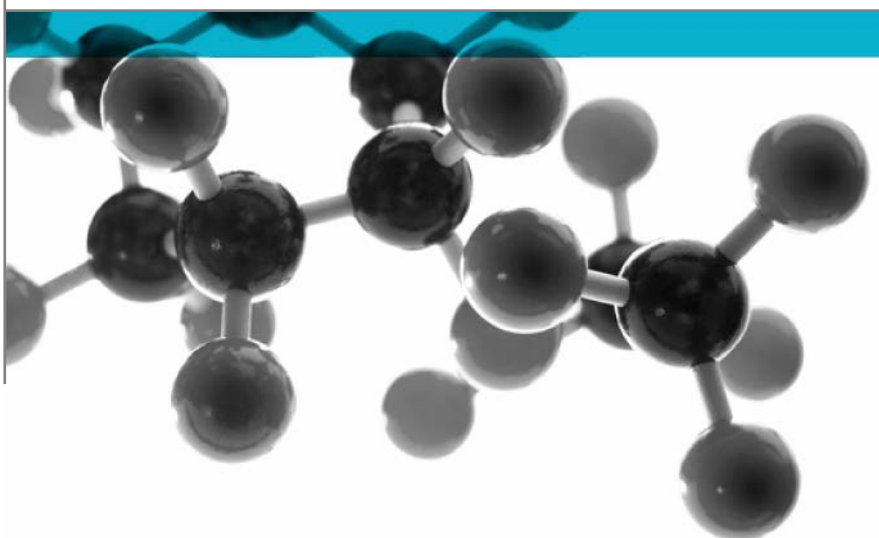

Electric Burner Test

A Report To: SMD Contracts Ltd.

Document Reference: 401513

Date: 6th December 2018

Issue No.: 2

Page 1



Executive Summary

Objective To determine the performance of the following product when tested in accordance with NFP 92-503.

Generic Description	Product reference	Thickness	Weight per unit area
Flame retardant grade polyester *(determined by Warringtonfire)	"Callisto and Lumar Fabric"	0.61mm*	267g/m ²
Please see page 5 of this test report for the full description of the product tested			


Test Sponsor SMD Contracts Ltd., Pitman Way, Fulwood, Preston, PR2 9ZD

Test Results: The results of this test, when assessed together with the results of the supplementary tests NFP 92-504 and NFP 92-505 test detailed in WF No. 402068 & WF No. 402069 respectively in accordance with the stipulations of the order from the Ministere de l'Industrie et de la Decentralisation, dated 28th August 1991 relating to reaction to fire, indicate that the specimens, as tested, are classified as M1.


Date of Test 4th July 2018

Reason for Revision This document replaces issue 1 (dated 9th November 2018) of the same number which has been withdrawn. The product reference has been amended in this issue 2 report.

Signatories



Responsible Officer
T. Mort *
Senior Technical Officer



Authorised
S. Deeming *
Business Unit Head

* For and on behalf of [Warringtonfire](#).

Report Issued: 6th December 2018

This version of the report has been produced from a .pdf format electronic file that has been provided by [Warringtonfire](#) to the sponsor of the report and must only be reproduced in full. Extracts or abridgements of reports must not be published without permission of [Warringtonfire](#).



CONTENTS	PAGE NO.
EXECUTIVE SUMMARY	2
SIGNATORIES.....	2
TEST DETAILS.....	4
DESCRIPTION OF TEST SPECIMENS.....	5
TEST RESULTS	6
TABLE 1.....	7
APPENDIX 1	8
REVISION HISTORY	9



Test Details

Purpose of test	<p>To determine the performance of specimens of a product when they are subjected to the conditions of the test specified in NFP 92-503 "Building – Reaction To Fire Tests; Electric Burner Test For Flexible Materials".</p> <p>The test was performed in accordance with the procedure specified in NFP 92-503 and this report should be read in conjunction with that Standard. The specimens were not subjected to the accelerated ageing test.</p>
Scope of test	<p>NFP 92-503 specifies a method of test which subjects test specimens to the effects of radiant heat and hot gases sweeping the surface of test specimens under specified conditions. A pilot flame is used to ignite any pyrolysis gases which may be formed. Ignition times, flame persistence and the nature of combustion and its effects are noted.</p>
Fire test study group/EGOLF	<p>Certain aspects of some fire test specifications are open to different interpretations. The Fire Test Study Group and EGOLF have identified a number of such areas and has agreed Resolutions which define common agreement of interpretations between fire test laboratories which are members of the Groups. Where such Resolutions are applicable to this test they have been followed.</p>
Instruction to test	<p>The test was conducted on the 4th July 2018 at the request of SMD Contracts Ltd., the sponsor of the test.</p>
Provision of test specimens	<p>The specimens were supplied by the sponsor of the test. Warringtonfire was not involved in any selection or sampling procedure.</p>
Conditioning of specimens	<p>The specimens were received on the 26th June 2018.</p> <p>Prior to testing the specimens were conditioned to constant mass at a temperature of $23 \pm 3^{\circ}\text{C}$ and a relative humidity of $50 \pm 10\%$.</p>
Specimen orientation	<p>Both faces of the specimens was exposed to the radiant heat of the test when the specimens were mounted in the test position.</p>

Description of Test Specimens

The description of the system given below has been prepared from information provided by the sponsor of the test. This information has not been independently verified by [Warringtonfire](#). All values quoted are nominal, unless tolerances are given.

Generic type	Flame retardant grade polyester
Product reference	"Callisto and Lumar Fabric"
Name of manufacturer	Zibo Dayang Textile
Weight per unit area	267g/m ² (stated by sponsor) 282.77g/m ² (determined by Warringtonfire)
Thickness	0.61mm (determined by Warringtonfire)
Colour reference	"Multi" (observed by Warringtonfire)
Pattern reference	"Design 1 & 2"
Type of weave	Jacquard
Thread count or threads per inch (TPI)	256
Yarn count	150D,30S
Flame retardant details	See Note 1 below
Brief description of manufacturing process	Yard-dye, jacquard weaving, heat set

Note 1. The sponsor of the test was unable to provide this information.

Test Results

Test results

The results of the tests are given in Table 1.

Observations taken during the test

In the case of each specimen a hole formed along the sample during the first 10 seconds of the test, resulting in there being no material present in the region of the burner.

In the case of each specimen tested, non-flaming droplets were observed.

Classification

The results of this test, when assessed together with the results of the supplementary tests NFP 92-504 and NFP 92-505 test detailed in WF No. 402068 & WF No. 402069 respectively in accordance with the stipulations of the order from the Ministère de l'Industrie et de la Décentralisation, dated 28th August 1991 relating to reaction to fire, indicate that the specimens, as tested, are classified as M1.

The indicated classification in no way prejudices the conformity of the materials commercialised to the samples submitted to the tests and can in no way be considered as a certificate of qualification as defined by the act of 10th January 1978. This conformity can be tested by the certificates of qualification acknowledged by the "Ministère de l'Industrie" and notably by the NF quality mark Réaction au feu.

The test procedures for classifying flexible materials of less than 5mm thickness are detailed in Appendix 1 to this report.

Durability of classification

The accelerated aging test has not been conducted

Applicability of test result

The test results relate only to the behaviour of the test specimens of the product under the particular conditions of test; they are not intended to be the sole criterion for assessing the potential fire hazard of the product in use.

The test results relate only to the specimens of the product in the form in which they were tested. Small differences in the composition or thickness of the product may significantly affect the performance during the test and may therefore invalidate the test results. Care should be taken to ensure that any product which is supplied or used is fully represented by the specimens which were tested.

Validity

The specification and interpretation of fire test methods are the subject of ongoing development and refinement. Changes in associated legislation may also occur. For these reasons it is recommended that the relevance of test reports over five years old should be considered by the user. The laboratory that issued the report will be able to offer, on behalf of the legal owner, a review of the procedures adopted for a particular test to ensure that they are consistent with current practices, and if required may endorse the test report.

This report may only be reproduced in full. Extracts or abridgements shall not be published without permission of [Warringtonfire](#).

Document No.: 401513
Author: T. Mort
Client: SMD Contracts Ltd.

Page No.: 6 of 9
Issue Date: 6th December 2018
Issue No.: 2



0249

Table 1

Initial Test Results

Specimen No.	Combustion Time (seconds)	Extent of Damage (mm)		Formation of Droplets	Non -Burning	Burning
		Length	Width			
1	0,0,0,0,0,0,0,0,0,0	170	-	Yes	Yes	No
2	0,0,0,0,0,0,0,0,0,0	150	-	Yes	Yes	No
3	3,0,0,0,0,0,0,0,0,0	170	-	Yes	Yes	Yes
4	0,0,0,0,0,0,0,0,0,0	110	-	Yes	Yes	Yes

On the basis of the results obtained during the initial tests, the formal test was completed on specimens cut in the direction of production with the 'outer' face exposed.

Formal Test Results

Specimen No.	Combustion Time (seconds)	Extent of Damage (mm)		Formation of Droplets	Non -Burning	Burning
		Length	Width			
3	3,0,0,0,0,0,0,0,0,0	170	-	Yes	Yes	No
5	0,0,0,0,0,0,0,0,0,0	100	-	Yes	Yes	No
6	0,0,0,0,0,0,0,0,0,0	170	-	Yes	Yes	No
7	0,0,0,0,0,0,0,0,0,0	150	-	Yes	Yes	No

Average Value for Combustion Times: 0.08 seconds
 Average Extent of Damaged Length: 147.5 mm
 Average Extent of Damaged Width: - mm

The specimens are designated "M1"



Appendix 1

Test Procedures For Classifying Flexible Materials Less Than 5mm Thick

Heat Radiation Test

These tests consist in submitting the samples, in clearly defined conditions, to the action of a radiating heat source and producing:

- (Articles 26 to 42)
- a) Ignition of the gases released, if it occurs,
 - b) Flame propagation.

The test sample (60 x 180 cm) inclined at 30° is submitted to a clearly defined radiation, emitted by an electric radiator, whose surface is 3.0 cm below the surface of the test sample. The gases released pass in contact with gas igniters located on either side of the test sample.

The duration of the test is 5 minutes.

Complementary Tests

Article 42: The materials which display very special behaviour during the tests are submitted to complementary tests.

Tests on Fusible Materials (Articles 43 to 45)

70 mm side square samples, so as to obtain a weight of over 2 g, are installed on a clearly defined metal grid, and submitted to the radiation of a radiator located 3.0 cm above. On each ignition it is moved aside and replaced after extinction, during the first 5 minutes; then for 5 further minutes, it remains in position.

The determining elements are:

- The presence or not of burning drops
- The ignition of the cellulose wool placed under the test sample.

Flame Propagation Tests (Articles 46 to 48)

The test sample (460 x 250mm) is submitted to the action of a small burner flame. The non-persistence or non-propagation of the flame is checked with the possible speed of propagation being checked between 2 marks 25cm apart.

Conditioning of the Samples

The samples submitted with normal dimensions are kept in a conditioned enclosure (23°C ± 3°C and 50% ± 10% relative humidity) until their mass has stabilised.

Classification of Materials

These are established subsequent to the above tests. Combustible materials are classified M.1, M.2, M.3, M.4. Only those materials classified M.1 can claim to M.0 classification (P.C.S. < 2500 kJ/kg, i.e. 600 kcal/kg).

(Articles 65 to 86)

Durability

To determine the durability of the classification, the tests are made in accordance with chapters 1 and 2 of appendix 22 which define the type of test to be applied to the material, depending on its nature, its use and its method of maintenance.

(Appendix 22)

Revision History

Issue No : 2	Re-issue Date: 6th December 2018
Revised By: T. Mort	Approved By: S. Deeming
Reason for Revision: This document replaces issue 1 (dated 9 th November 2018) of the same number which has been withdrawn. The product reference has been amended in this issue 2 report.	

Issue No :	Re-issue Date:
Revised By:	Approved By:
Reason for Revision:	

